


Trinity Aquifer—Drought Status Report

STAGE 1: 10% Reduction Recommended

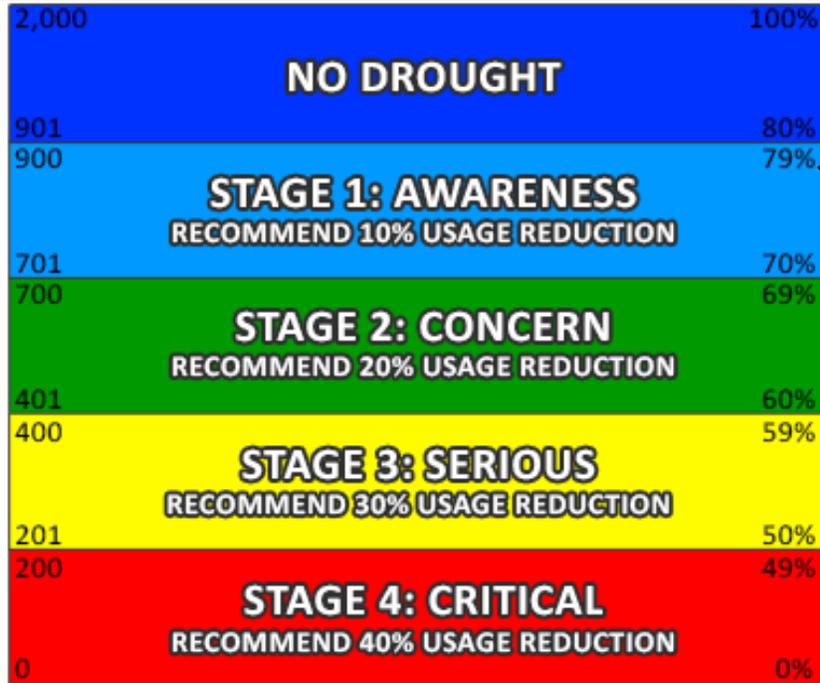


25.83 PDI
78.27 %

PDI is based on a 33" normal yearly average and is a 365 day running total.

AS OF 6/20/18

Clearwater UWCD is concerned that drought conditions are upon us thus if no measurable rainfall is experienced by June 22, then all well owners producing from the Trinity Aquifer will need to voluntarily curtail production by 10%.

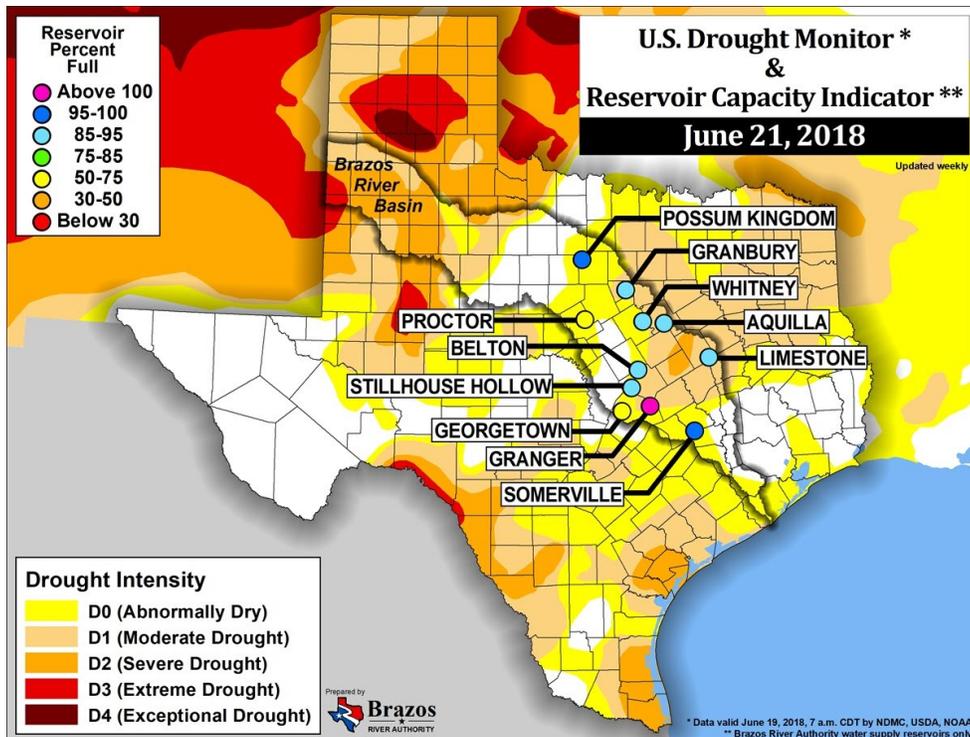

Drought Stage Response

The water conservation goals and usage reduction measures assigned to each drought stage are voluntary. The District encourages voluntary compliance during each drought stage as outlined in this plan. Such voluntary compliance will contribute to the achievement of the desired level of conservation and reduce the impact of drought conditions and restrictions. However, nothing in this section excludes the District from exercising authority under District Rules regarding wasteful use of water.

Stage 1: Awareness - Conservation Goal: 10% reduction

Usage Reduction Measures:

- Continue or increase voluntary reduction in various uses.
- Check for and correct all plumbing leaks.
- Re-use or re-circulate water whenever possible.
- No filling of ponds, lakes, tanks, reservoirs, swimming pools or other surface impoundments for holding water that have a total capacity of more than 50,000 gallons, except for public water supply systems.
- Public water supply systems are encouraged to implement measures to achieve a 10% reduction in water usage.